G R S App I IX 4]

Previous References

194 2 -

(ML)

File No 71-42

Serial Nos 1, 2, 3

ter References

GENERAL AND REVENUE SECRETARIAT

Serial Nos

✓

Part B for August 42

SUBJECT

Installation of a duplicate pump set for the Nanganur water works

sd 2)

To,

The Dire of P H
The D e Mysore
The comptroller
The secry S P C
L 407-10 dt 14 7 42
Sanctions the —

hrs 20 8 42

D.O.No C 56-22 Ee one Statement

P PARTHASARATHY Esq LMS BSSc
LRCP LRC DTM DPH
Director of Public Health

Office of the Director of Public Health in Mysore

BANGALORE

69/L

Dated 30th June 1942

Mc 71-42-1.

GEN & R.I SECRETARIAT 2 JULY 1942 L & C BRANCH

LOY LAW DEPT 2 JULY 1942 GOVT OF MYSORE

The Secretary to Government,
Law Department, Bangalore

I have the honour to state that an estimate for Rs 7988/- was sanctioned in G O No X 6164-66/41 98-40-15 dated 18-2-1941 for duplicating the pumping set for supply of water to Nanjangud town and funds were also placed at the disposal of the Sanitary Bureau Orders were placed with Messrs Kirloskar Bros , through the Secretary, Stores Purchase Committee, Bangalore, in local Indent No 6452 dated 11-12-41 for the supply of high lift pump with parts The cost aggregate to Rs 2,831/- as per details in the enclosed statement The bill of the firm is received and is awaiting payment

I request you to be so good as to obtain and convey early sanction of Government for the purchase of the pumping set and its parts at the price of Rs 2,831/- so that the bill of the firm may be passed for payment

141/47

I have the honour to be,
Sir,
Your Most obedient servant,

DIRECTOR OF PUBLIC HEALTH

1) Rules with a draft G.O, for affl

2) May be approved

Law Secy

3) Sanctioned

4) Action should have been taken immediately after the orders were passed in Feb 41 The delay in this matter is highly unsatisfactory. The explanations of the officers responsible

OFFICE OF THE MINISTER FOR L S G & P H Date 6.7.1942 No 231

2) ML 71-42 — 557

for the delay should be obtained immediately & the tally should write

Sd
11/7/42

Cus 11-7-42

5 I have returned with a draft letter (6)

To The Dir of P H
The D of Mysore
The Comptroller
The Secy SPC
L 407-10/Ml/71-42-2 of 4/7/42

~~Draft letter to the Dir of P H for approval~~
sanction the purchase of the
tractorery at a Cost of Rs 2831/-
Submitted with a draft D.O. letter to the
Dir of P H. for approval

11/7 Cus

GEN &

Law Secy 8) 15/7 Cus

Draft 15/7
CS 15/7

611/11/7 Cus

9 Cus 16-7-42

To, The Dir of P H
L 600 of 17/7/42

10) Dir of P H 16/7 Cus

Calls for the explanation of the officers responsible for the delay

Sus A 17/7/42

From The Dir of P H
No C56-26 of 23/7/42.
Furnishes a report in the matter

11) The letter of the Dir of P H, which is self-explanatory is submitted for favour of perusal orders on the reference to the orders of the Minister at para 4 above.

Draft 25/7
CS

(3

552/L Installation of a duplicate Pumping set at the Nanyanga water works

General and Revenue Secretariat — File No 71 of 1942 — [App F III—2

Serial No

1/ The letter of the Director of Public Health is for perusal

2/ After the G.O. sanctioning the estimate in question was issued in July 1941, there was a delay of four months on the part of the D.C. Nyanza both in arranging the amount required for the account of the Sanitary Engineer this was done in June 1942. The D.C. should have done this immediately on the Sanitary Engineer having reported

3/ It has taken another five months for placing orders and getting the machinery required, since the Leg. S.P. it has been received & the work is in progress.

4/ For perusal with regard to the Minister's orders at para 2 supra

Law Leg J Lee
27/7/42

For perusal

The order was passed to San Eng on 25-2
The San Eng's minutes & DC on 2-4
DC forwarded to Medical
San Eng's reminder Reminder 19-5
San Eng's minutes & SP Con 7-7
Reminder cannot now be
Marked 11-1

SEC DEPT 1001 27 1942 NOORE

NOTE—Contn Sheet

WD 04155—GPB—55 000—23 10 41

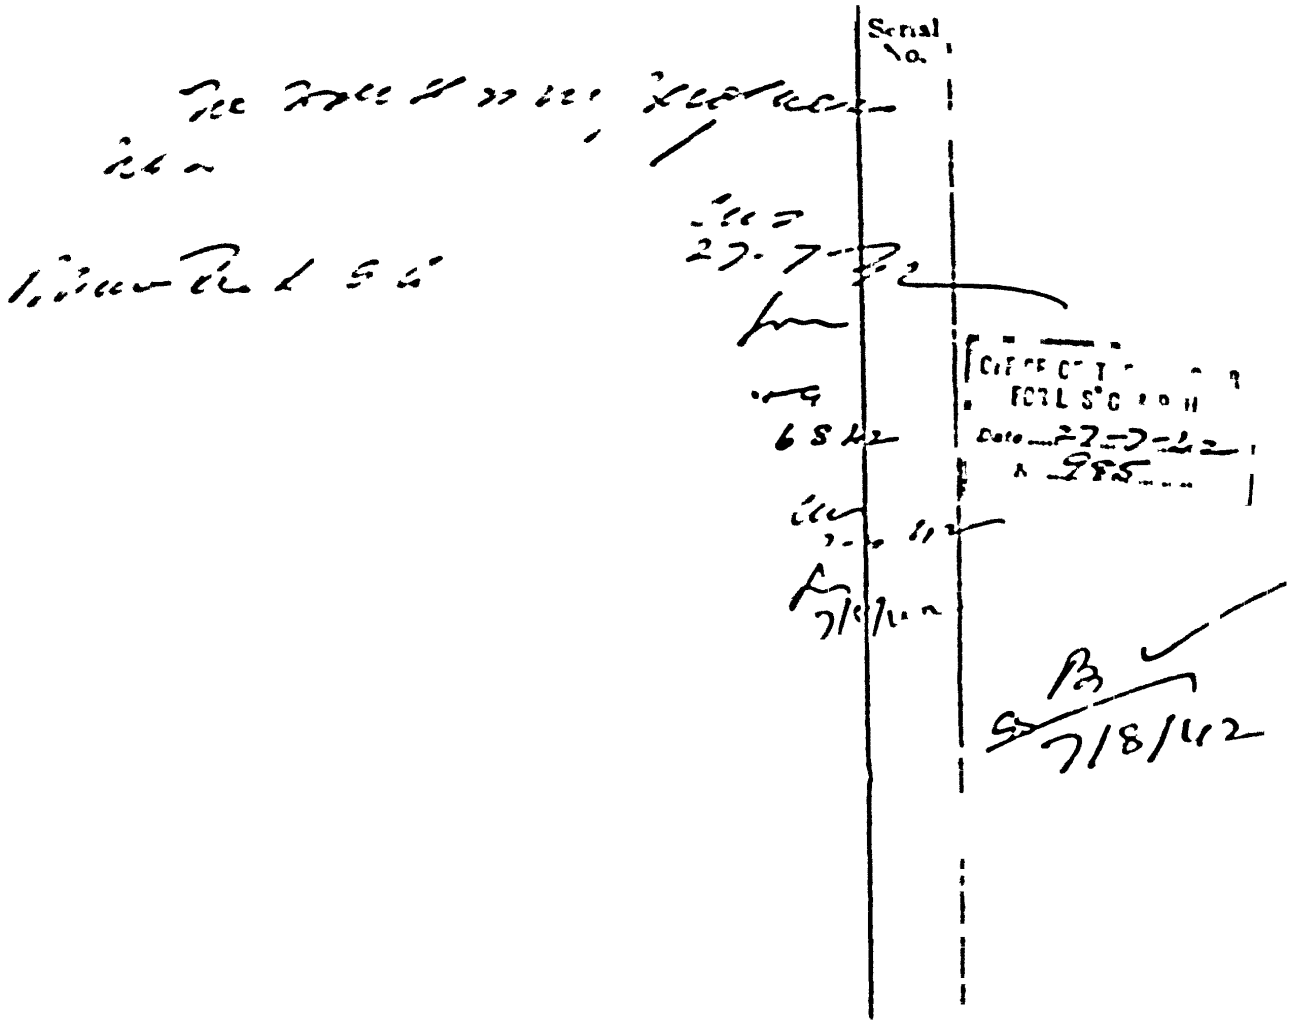
Serial No.

			1,810/-
Heavy Type Set Spanners	ONE SET	"	15/-
Bearings for the Pump	ONE SET	"	18/-
Rotating Element comprising of one shaft and sleeves, two Impellers one set of renewable neck rings, lock nuts etc , complete	ONE SET		220/-
5 Ball and Roller Bearings suitable for the above Brooks Motor	ONE SET		50/-
Rubber Bushes for flexible couplings	ONE SET		5/-
			2,178/-
30% increase as per S F C Secretary's letter No 20271 dated 5th January 1942			653/-
	Total £		2,831/-

"Copy"

G. H. Leshoon
Director of Public Health

JBR

schedule or order placed. It is necessary [illegible] ,
Krishnarajapuram, and [illegible] etc.

---

1 Name and address of consignee — The Superintendent, Anti Filaria Station Workshop, Mysore

Name and address of officer to whom railway receipt should be sent — -do-

3 Name and address of officer to whom bills of cost should be sent in duplicate — The Sanitary Engineer, Board of Sanitary Engineering, Bangalore

4 Terms of delivery — Immediately from stocks

Item No.	Description of materials	Quantity to be supplied	Rate accepted
	1.h.p. lift-cum-irrigation set -		C.R. Manjanadi
1	"Kirloskar Dam" type, ball bearing horizontally split case two stage single suction, centrifugal pump, fitted with a pair of companion flanges, and with Tin type flexible couplings only and with combined bed plate of rigid construction to accommodate and for direct coupling to the induction motor noted below	ONE	Rs. 650/-
a	The above pump tapped for 3" suction and 2½" discharge and should be generally as described, illustrated and fully specified from pages 5 to 10 of your centrifugal pump list 10/12 of 1955, and the pump should be capable of discharging 118 G.P.M. at a total head of 100 feet from all causes requiring 9.5 B.H.P. for this duty and 138 G.P.M. at a total head of 120 feet from all causes requiring 9.5 B.H.P.		
	Ground mire, 12.5 H.P., screen protected type squirrel cage induction motor of 1000 R.P.M. rating, on 3 phase, 50 cycles, 440 volts, A.C. supply, for direct coupling to the above pump	ONE	Rs. 700/-
3	George Kilburn Oil Immersed type star delta starter fitted with one no-volt and three over-load releases	ONE	Rs. 360/-
	The starter should have free handle in the run position and fitted with correct cable box device		
	1 Kirloskar make, 2½" size, R.V. delivery valve (duly to operate with hand wheel (sluice valve)	One	Rs. 25/-
	2½" size, Foot-return valve or English Make ( )		Rs. 25/-
	Suitable pressure gauge with operating cock reading 0-150 feet head	ONE	Rs. 20/-
	Suitable double gauge with open ring cock for the above pump	ONE	Rs. 35/-
		Total	Rs. 1810/-

G R S App F VI—G 2]

SUBJECT

Read

Diary No of letter replied to 69

Section Irl

File No 71-42

Serial No 2

General and Revenue Secretariat

( )

the 193

Proceedings of the Government of His Highness the Maharaja of Mysore

Date of issue 14 7 42 193

Signed by M C Rao

Read— 1) G.O. No. L 6164-66/ml 98-40-1. Dt 18/2/41 sanctioning an estimate for Rs 7988/- for duplicating the Pumping sch. the Nanjangud water Supply wo.

May this be —

(i) printed ?

(ii) treated as a standing order ?

(iii) published in the Gazette English Part ?

(iv) translated ?

(v) placed at the disposal of the press ?

(vi) published in the Gazette Kannada Part ?

2) Letter No C 56-22 dt 30/6 ~~C Ho 4 dt 3~~ from the Dir of P. It reques. sanction in the circumstances stated to the purchase through the S.P.C of a Pumping Sch for the Nanjangud waterworks at a Cost of Rs 2831/-

Order thereon—No

Order No L 407- dt 5/7/42 sanctioned

To, The Dir of P. It
The D.C. Mysore Dt
The Controller of Stores
Secy. Finance Purchase Committee

Secretary
M C Rao

List of Enclosure

Copied by

Examined by

WD 0564—GPB—22 500—9 1 39

Agha

PROCEEDINGS OF THE GOVERNMENT OF HIS HIGHNESS THE MAHARAJA OF MYSORE

Read —

1) Government Order No.L.6164-66/Ml.98-40-13 dated 18th February 1941 sanctioning an estimate for Rs.7,988/- for duplicating the pumping set of the Nanjangud Water Supply Works.

2) Letter No.C.56-62 dated 30th June 1942 from the Director of Public Health, requesting sanction, in the circumstances stated, to the purchase, through the Stores Purchase Committee of a pumping set and its parts for the Nanjangud Water Works at a cost of Rs.2,631/-.

*****

Order No.L. 407-10/Ml 71-42-2

Dated, Bangalore, 14th July 1942.

S a n c t i o n e d.

For Secretary to Government
Law Department.

To—The Director of Public Health in Mysore.
The Deputy Commissioner, Mysore District.
The Comptroller to Government.
The Secretary, Stores Purchase Committee.

bv.5.

Appendix F G—1]

SUBJECT

✓

Diary No of letter replied to

General and Revenue Secretariat

( )

the *19*

Date of issue 17.7.42

Signed by

List of enclosures

Copied by

Examined by

Confidential

Section Rel

File No 71-42

✓

Serial No 3

Do L 600

No Dear Sir,

To In Continuation of G.O No LR607-10/Rel 71-42-2 dy 14/7/42 sanctioning the purchase of a pumping set for the Navjaungud water Suffly work at a Cost of Rs 2831/- I am directed to state that action should have been taken immediately after the orders sanctioning the estimate for Rs 7988/- for the duplication of the pumping machinery were passed in February 1941 The delay in this matter is highly unsatisfactory and the explanations of the officers responsible for the delay should be obtained immediately and suitable action dealt with

I am to request that the report of action taken in this behalf should be submitted to Govt very early

Yours faithfully

Sd/- Secy to Govt Law Deptt

To The Dir P W.

WD 086—GPB—40 000—30 7 40

GOVERNMENT OF HIS HIGHNESS THE MAHARAJA OF MYSORE

General and Revenue Secretariat

D O No L 600 Mel71-42-3 *Dated Bangalore,* 17 July 1942.

/Confidential/

Dear Sir,

In continuation of Government Order No L 407-10/Ml 71-42-2, dated the 14th July 1942, sanctioning the purchase of a pumping set for the Nanjangud Water Supply Works at a cost of Rs 2,831/-, I am directed to state that action should have been taken immediately after the Orders sanctioning the estimate for Rs 7,988/- for the duplication of the Pumping Machinery were passed in February 1941. The delay in this matter is highly unsatisfactory and the explanations of the Officers responsible for the delay may kindly be obtained and forwarded immediately to Government

Yours sincerely,

For Secretary to Govt

To The Secretary to Government,
Law Department

P Parthasarathi, Esq , L M S , B S Sc ,(Mad),
L R C P & S (Edin), D T M (Lond), D P H (Camb),
Director of Public Health in Mysore,
Bangalore

552/L

No C56-26

OFFICE OF THE DIRECTOR OF PUBLIC HEALTH
IN MYSORE, BANGALORE,
Dated, 22nd July 1942

"CONFIDENTIAL"

To

The Secretary to Government,
Law Department, Bangalore

GEN & REV SECRETARIAT
24 JULY 1942
L S G BRANCH

SECT. LAW DEPT
21 JUL 42
GOVT OF MYSORE

Duplication of pumping machinery for the Nanjangud Water Supply

With reference to your D O letter No L 600/A1 71-42-3 dated 17th July 1942 re the delay in taking action on receipt of the Government Order of 18-2-41 sanctioning the estimate for Rs 7988/- for the above, I have the honour to state that a copy of the Government Order was sent to the Sanitary Engineer with this office No C 212-16 dated 22/25-2-1941 for action

On receipt of the Government Order from this office, the Sanitary Engineer has addressed the Deputy Commissioner, Mysore on 2-4-1941 to draw the Government share of cost viz , Rs 3994 and to place the same at the disposal of the Bureau of Sanitary Engineering This was not actually done until 17th June 1941, though the Deputy Commissioner, Mysore with his letter No D 3-480/40-41 dated 19-4-1941 returned the bill for Rs 3994/- duly countersigned to the President, Nanjangud Municipality

After receipt of the advice of credit of the Government share viz , Rs 3994/- the Sanitary Engineer addressed the Secretary, Stores Purchase Committee in his No 129 dated 7th July 1941 for the supply of the low and high lift pumping machinery But the orders could not be placed by the Secretary, Stores Purchase Committee until 11-12-1941 due to non-availability of requisite machinery, rates, etc and the matter was in correspondence with the Secretary, Stores Purchase Committee, and the Sanitary Engineer The requisite machinery however, has now been received and the work is in progress

From the foregoing it will be seen that the Government grant was drawn and placed at the disposal of the Bureau of Sanitary Engineering only

[illegible] level, immediately after which the sanitary [illegible] for the supply of the requisite machinery, and the work of getting the machinery was [illegible] of the present market conditions

I have the honour to be,
Sir,
Your most obedient servant,

[illegible]